



SAMPLE REPORT

Power Availability Report

Jun 20, 2023, 12:00:00 AM - Sep 18, 2023, 11:59:59 PM


Sep 18, 2023, 1:01:19 PM

Copyright (c) 2023 Franklin Electric. All rights reserved. Version 1.4.0.1694567093 Unreleased (Cloud/EFI)

NexPhase

NexPhase Name	Jubilee Park
NexPhase Type	NexPhase 600
Relay Controller Device ID	44-454D-4F52-4330-32
Input DTM Device ID	44-454D-4F54-4D30-36
Charger 1 Name	Charger 1
Charger 2 Name	Charger 2
Charger 3 Name	Charger 3
Charger 4 Name	Charger 4
Charger 1 DTM Device ID	44-454D-4F54-4D30-37
Charger 2 DTM Device ID	44-454D-4F54-4D30-38
Charger 3 DTM Device ID	44-454D-4F54-4D30-39
Charger 4 DTM Device ID	44-454D-4F54-4D31-30

Site Outage Type Frequency

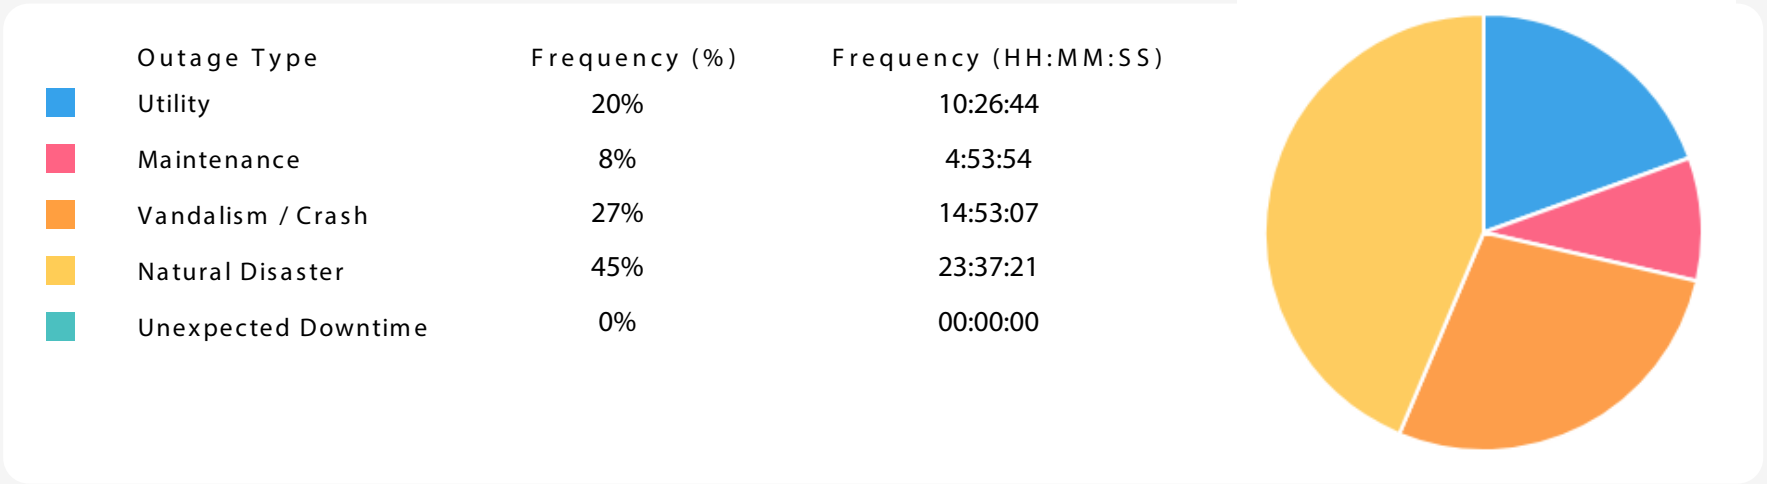

Charger Power Availability

Charger 1

Power Availability

Power Availability with NEVI Exclusions

Current NEVI Status

92%

97%

Compliant



Charger 2

Power Availability

Power Availability with NEVI Exclusions

Current NEVI Status

92%

100%

Compliant



Charger 3

Power Availability

Power Availability with NEVI Exclusions

Current NEVI Status

95%

97%

Compliant



Charger 4

Power Availability

Power Availability with NEVI Exclusions

Current NEVI Status

92%

100%

Compliant



Outage History

Device	Start	Duration (HH:MM:SS)	Outage Type
Charger 1	May 4, 2023, 9:00:43 AM	1:59:37	Maintenance
Charger 1	May 4, 2023, 8:00:23 AM	1:00:19	Vandalism
Charger 1	May 1, 2023, 8:01:32 AM	6:14:19	Utility
Charger 2	May 1, 2023, 8:01:32 AM	6:14:19	Utility
Charger 3	May 1, 2023, 8:01:32 AM	6:14:19	Utility
Charger 4	May 1, 2023, 8:01:32 AM	6:14:19	Utility